

Water Supply

Note: These requirements are contained at Table 2 of Clause 53.02-5 and must not be changes unless agreed in writing by CFA

Water Supply

Show **2, 500 / 5,000 / 10,000** litres of effective water supply for fire fighting purposes must be provided which meets the following requirements:

- Is stored in an above ground water tank constructed of concrete or metal.
- All fixed above-ground water pipes and fittings required for firefighting purposes must be made of corrosive resistant metal.
- Include a separate outlet for occupant use.

Additional conditions to apply if CFA fittings and access is required (i.e. 10,000 litres)

- Be readily identifiable from the building or appropriate identification signage to the satisfaction of CFA must be provided.
- Be located within 60 metres of the outer edge of the approved building.
- The outlet/s of the water tank must be within 4m of the accessway and be unobstructed.
- Incorporate a separate ball or gate valve (British Standard Pipe (BSP 65 millimetre) and coupling (64 millimetre CFA thread per inch male fitting).
- Any pipework and fittings must be a minimum of 65 mm (excluding the CFA coupling).

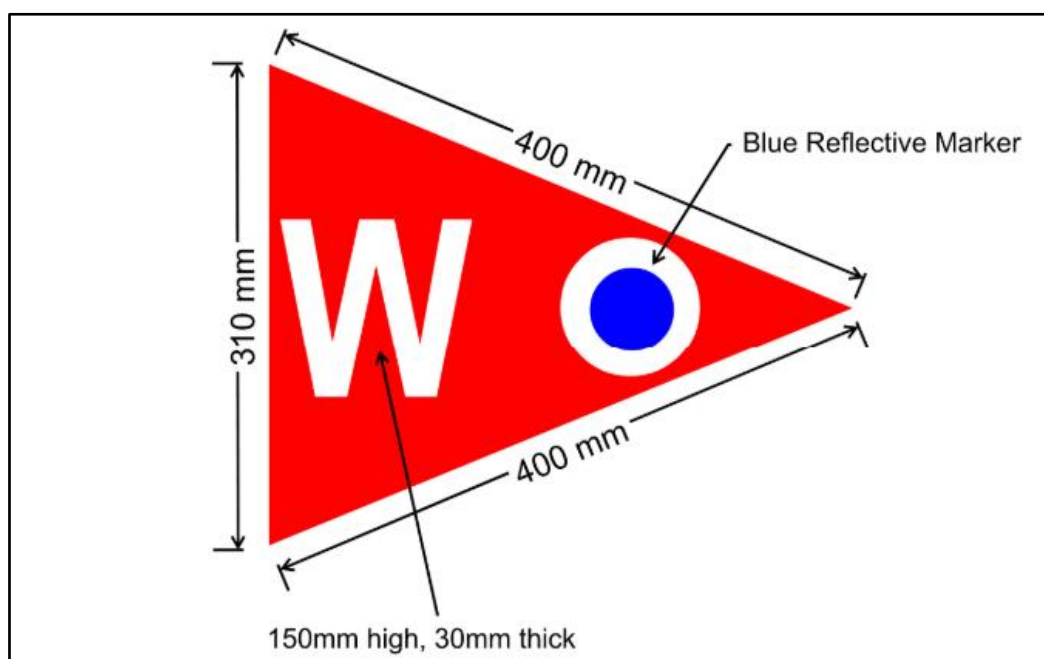


Figure 1: Signage specifications (if required)